



— BUREAU OF —
RECLAMATION

Boysen Reservoir Operations

Water Supply Forecasts and Reservoir Operations



Prepared January 2026

End of December Elevation and Storage: 4712.01 FT & 521,099 Acre-Feet

Actual Inflows (1,000 Acre-Feet):

<u>Month</u>	<u>Inflow</u>	<u>Percent of Normal</u>
December 24	35.6	90
January 25	26.3	69
February 25	31.3	81
March 25	50.8	95
April 25	42.5	81
May 25	97.3	68
June 25	143.6	48
July 25	37.1	27
August 25	30.9	61
September 25	26.5	56
October 25	39.5	69
November 25	42.4	85
December 25	39.5	99

BOYSEN RESERVOIR

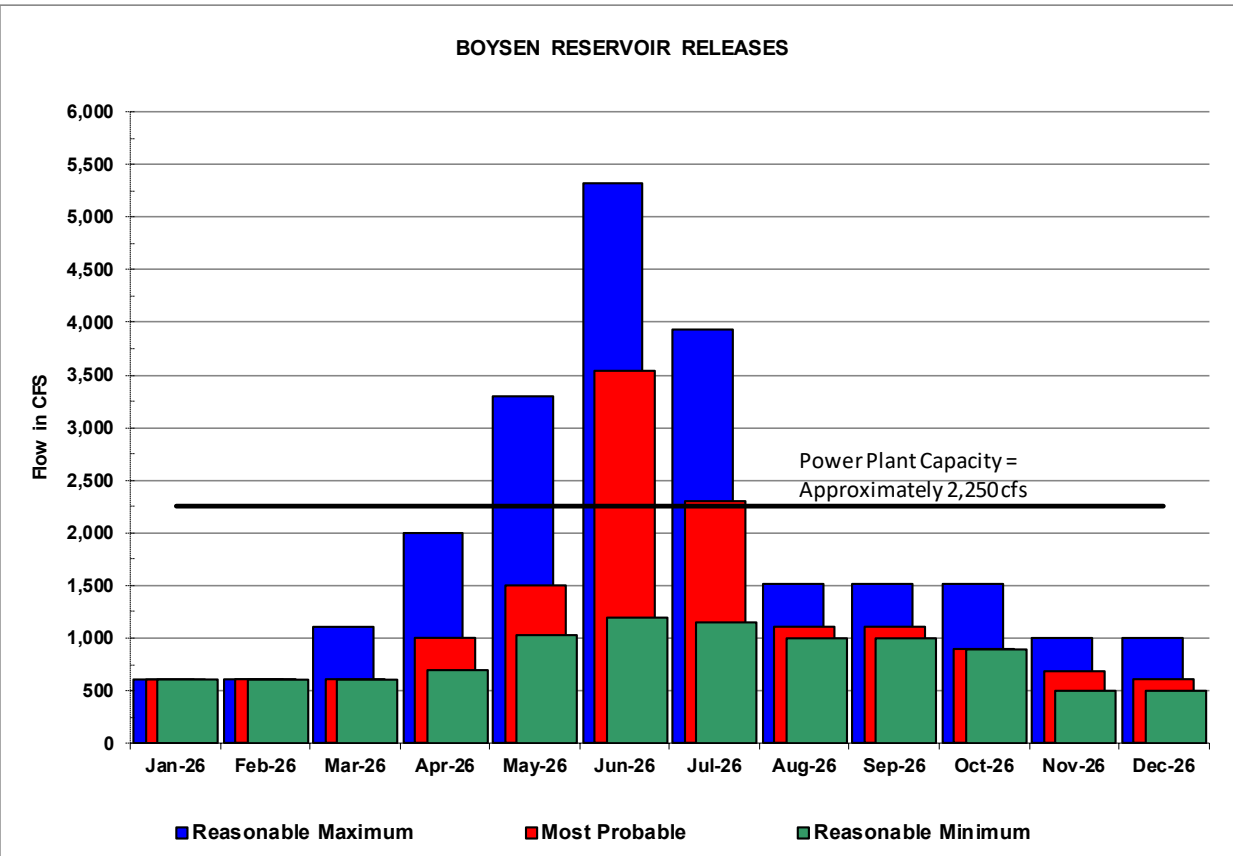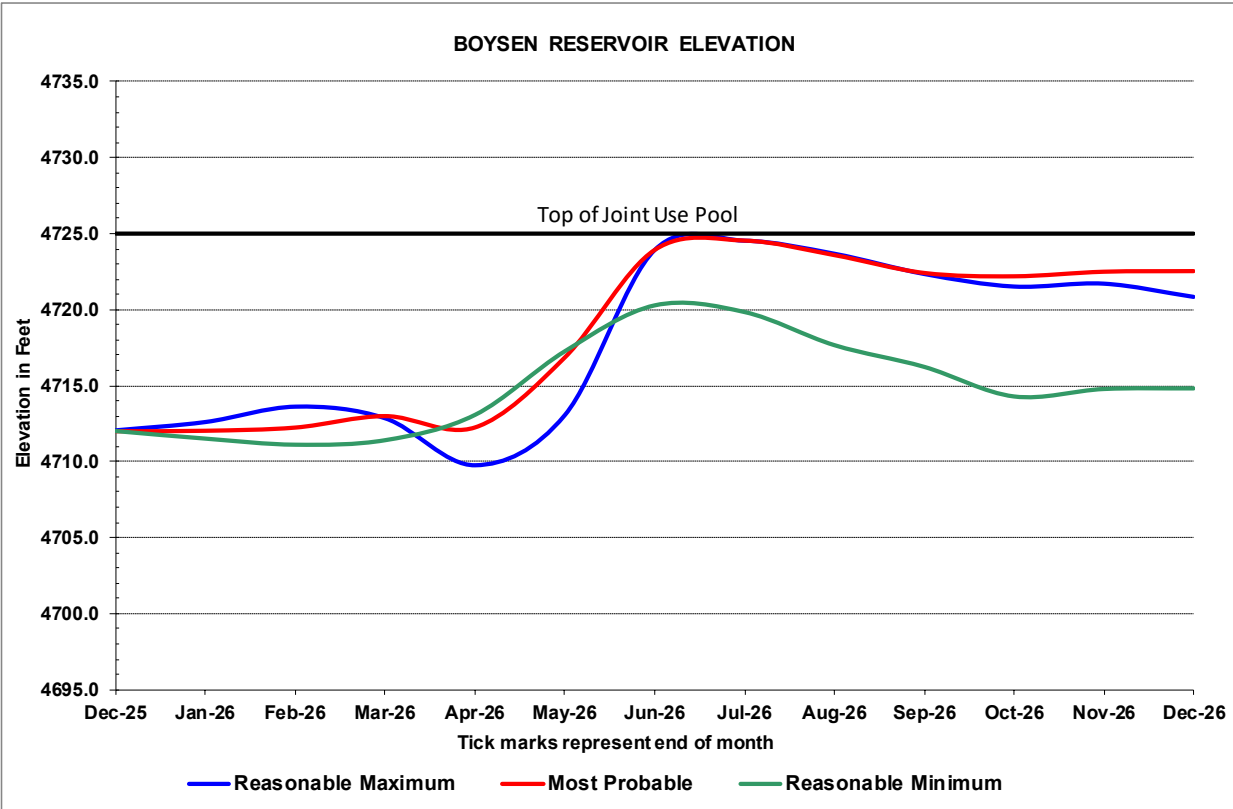

Note: Boysen Power Plant will be offline from January through August 2026.

BOYAOP V1.48 Run: 07-Jan-2026 10:30
Based on Most Probable April - July Inflows of 700 KAF.

Boysen Reservoir		BOYSEN RESERVOIR MONTHLY OPERATIONS													
		Initial Cont			521.1 kaf		Maximum Cont			892.2 kaf		Minimum Cont		219.2 kaf	
		Elev			4712.01 ft		Elev			4732.20 ft		Elev		4685.00 ft	
2026		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total	
Monthly Inflow	kaf	37.3	36.4	47.8	48.7	162.5	335.2	153.6	50.0	43.5	51.1	46.6	37.8	1050.5	
Monthly Inflow	cfs	607	655	777	818	2643	5633	2498	813	731	831	783	615		
Turbine Release	kaf	5.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	65.5	55.3	15.4	36.9	178.4	
Bypass/Spill/Waste	kaf	31.6	33.3	36.9	59.5	92.2	210.2	141.7	68.3	0.0	0.0	25.6	0.0	699.3	
Total Release	kaf	36.9	33.3	36.9	59.5	92.2	210.2	141.7	68.3	65.5	55.3	41.0	36.9	877.7	
Total Release	cfs	600	600	600	1000	1499	3533	2305	1111	1101	899	689	600		
End-Month Content	kaf	521.5	524.6	535.5	524.7	595.0	720.0	731.9	713.6	691.6	687.4	693.0	693.9		
End-Month Elevation	ft	4712.04	4712.25	4713.00	4712.26	4716.85	4723.89	4724.50	4723.55	4722.38	4722.16	4722.46	4722.50		
Net Change Content	kaf	0.4	3.1	10.9	-10.8	70.3	125.0	11.9	-18.3	-22.0	-4.2	5.6	0.9	172.8	
Boysen Power Plant	2026	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total	
Turbine Release	kaf	5.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	65.5	55.3	15.4	36.9	178.4	
Turbine Release	cfs	86	0	0	0	0	0	0	0	1101	899	259	600		
Generation	gwh	0.433	0.000	0.000	0.000	0.000	0.000	0.000	0.000	5.889	4.957	1.386	3.334	15.999	
Max Generation	gwh	0.440	0.000	0.000	0.000	0.000	0.000	0.000	0.000	11.520	11.904	1.382	11.904	37.150	
% Max Generation	%	98	0	0	0	0	0	0	0	51	42	100	28		
Ave kwh/af		82								90	90	90	90	90	
End-Month Power Cap	mw	16	16	16	16	16	16	16	16	16	16	16	16		

BOYAOP V1.48 Run: 07-Jan-2026 10:30
Based on reasonable MINIMUM April - July Inflows of 380 KAF.

Boysen Reservoir		BOYSEN RESERVOIR MONTHLY OPERATIONS												
		Initial Cont			521.1 kaf	Maximum Cont			892.2 kaf	Minimum Cont			219.2 kaf	Total
		Elev	4712.01 ft		Elev	4732.20 ft		Elev	4685.00 ft					
2026	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec		
Monthly Inflow	kaf	29.7	27.6	41.2	65.9	128.1	123.2	62.8	24.2	36.3	25.0	37.3	31.3	632.6
Monthly Inflow	cfs	483	497	670	1107	2083	2070	1021	394	610	407	627	509	
Turbine Release	kaf	5.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	59.5	55.3	16.4	30.7	167.2
Bypass/Spill/Waste	kaf	31.6	33.3	36.9	41.7	63.0	71.4	70.7	61.5	0.0	0.0	13.4	0.0	423.5
Total Release	kaf	36.9	33.3	36.9	41.7	63.0	71.4	70.7	61.5	59.5	55.3	29.8	30.7	590.7
Total Release	cfs	600	600	600	701	1025	1200	1150	1000	1000	899	501	499	
End-Month Content	kaf	513.9	508.2	512.5	536.7	601.8	653.6	645.7	608.4	585.2	554.9	562.4	563.0	
End-Month Elevation	ft	4711.51	4711.11	4711.41	4713.08	4717.27	4720.29	4719.85	4717.67	4716.24	4714.29	4714.78	4714.82	
Net Change Content	kaf	-7.2	-5.7	4.3	24.2	65.1	51.8	-7.9	-37.3	-23.2	-30.3	7.5	0.6	41.9
Boysen Power Plant	2026	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
Turbine Release	kaf	5.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	59.5	55.3	16.4	30.7	167.2
Turbine Release	cfs	86	0	0	0	0	0	0	0	1000	899	276	499	
Generation	gwh	0.432	0.000	0.000	0.000	0.000	0.000	0.000	0.000	5.066	4.640	1.378	2.587	14.103
Max Generation	gwh	0.440	0.000	0.000	0.000	0.000	0.000	0.000	0.000	11.520	11.904	1.382	11.904	37.150
% Max Generation	%	98	0	0	0	0	0	0	0	44	39	100	22	
Ave kwh/af		82								85	84	84	84	84
End-Month Power Cap	mw	16	15	16	16	16	16	16	16	16	16	16	16	

BOYAOP V1.48 Run: 07-Jan-2026 10:30
Based on Reasonable Maximum April - July Inflows of 1080 KAF.

Boysen Reservoir		BOYSEN RESERVOIR MONTHLY OPERATIONS												
		Initial Cont		521.1 kaf		Maximum Cont		892.2 kaf		Minimum Cont		219.2 kaf		Total
			Elev	4712.01 ft		Elev	4732.20 ft		Elev	4685.00 ft				
	2026	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Monthly Inflow	kaf	44.9	48.3	56.1	75.1	250.1	500.9	253.8	76.3	65.0	77.6	63.0	45.7	1556.8
Monthly Inflow	cfs	730	870	912	1262	4067	8418	4128	1241	1092	1262	1059	743	
Turbine Release	kaf	5.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	90.0	92.9	15.5	61.5	265.2
Bypass/Spill/Waste	kaf	31.6	33.3	67.6	119.0	202.9	316.8	241.9	92.9	0.0	0.0	44.0	0.0	1150.0
Total Release	kaf	36.9	33.3	67.6	119.0	202.9	316.8	241.9	92.9	90.0	92.9	59.5	61.5	1415.2
Total Release	cfs	600	600	1099	2000	3300	5324	3934	1511	1513	1511	1000	1000	
End-Month Content	kaf	529.1	544.1	532.6	488.7	535.9	720.0	731.9	715.3	690.3	675.0	678.5	662.7	
End-Month Elevation	ft	4712.56	4713.57	4712.80	4709.71	4713.02	4723.89	4724.50	4723.64	4722.31	4721.48	4721.67	4720.80	
Net Change Content	kaf	8.0	15.0	-11.5	-43.9	47.2	184.1	11.9	-16.6	-25.0	-15.3	3.5	-15.8	141.6
Boysen Power Plant	2026	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
Turbine Release	kaf	5.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	90.0	92.9	15.5	61.5	265.2
Turbine Release	cfs	86	0	0	0	0	0	0	0	1513	1511	260	1000	
Generation	gwh	0.435	0.000	0.000	0.000	0.000	0.000	0.000	0.000	8.046	8.223	1.378	5.451	23.533
Max Generation	gwh	0.440	0.000	0.000	0.000	0.000	0.000	0.000	0.000	11.520	11.904	1.382	11.904	37.150
% Max Generation	%	99	0	0	0	0	0	0	0	70	69	100	46	
Ave kwh/af		82								89	89	89	89	89
End-Month Power Cap	mw	16	16	16	14	15	16	16	16	16	16	16	16	